



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**ACME Engineering and Manufacturing Corporation**  
1820 N. York Street  
Muskogee, OK 74403

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** Series PV260, PV300 & PV365 Aluminum Rooftop Exhaust Fans

**APPROVAL DOCUMENT:** Drawing No. 686790, titled "Large Size PV Hurricane Fans" sheets 1 through 3 of 3, dated 03/26/2013, with revision A dated 06/02/2015, prepared by ACME Engineering and Manufacturing Corporation, signed and sealed by Richard Boyette, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING:** Large and Small Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 14-0505.11 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



*[Signature]*  
08/31/2015

NOA No. 15-0622.18  
Expiration Date: July 24, 2019  
Approval Date: September 3, 2015  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **686790**, titled "Large Size PV Hurricane Fans" sheets 1 through 3 of 3, dated 03/26/2013, prepared by ACME Engineering and Manufacturing Corporation, signed and sealed by Richard Boyette, P.E.

**B. TESTS "*Submitted under NOA # 14-0505.11*"**

1. Test report on 1) Uniform Static Air Pressure Test per FBC, TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94,  
3) Tensile Strength Test per ASTM E8,  
along with marked-up drawings and installation diagram of Model PV260 and PV365 Aluminum Exhaust Fans, prepared by Architectural Testing, Inc., Test Report No. **C9311.01-801-18**, dated 11/14/2013, signed and sealed by Vinu J. Abraham, P.E.

**C. CALCULATIONS "*Submitted under NOA # 14-0505.11*"**

1. Anchor calculations prepared by Rick Boyette Consulting Inc., dated 03/14/2014, signed and sealed by Richard Boyette, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to the 5<sup>th</sup> edition (2014) FBC issued by Rick Boyette Consulting, Inc, dated 06/02/2015, signed and sealed by Richard Boyette, P.E.
2. No financial interest letter issued by Rick Boyette Consulting, Inc, dated 06/29/2015, signed and sealed by Richard Boyette, P.E.




08/31/2015

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 15-0622.18


Expiration Date: July 24, 2019  
Approval Date September 3, 2015

Large Missile Impact Resistant  
Max rated design pressure : +100.0 / -175.0 PSF


- Notes:
- a. This rooftop exhaust fan has been designed to comply with the Florida Building Code.
  - b. Roof structure must be designed to withstand the weight and loading transmitted by this rooftop exhaust fan.
  - c. This approval is for the structural capacity of the exterior housing only, it does not include any interior mechanism and/or electrical part.
  - d. This rooftop exhaust fan has not been tested for wind driven rain according to Florida Building Code, TAS 100(A). It cannot be installed within the ridge area FBC 1523.6.5.2.13.
  - e. All fasteners must be corrosion resistant.

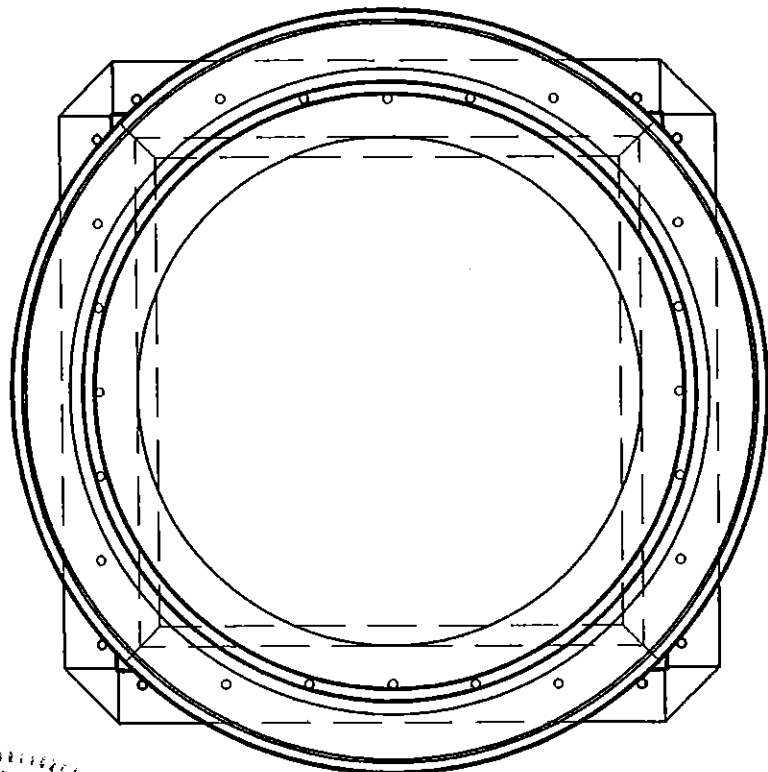

Plan View

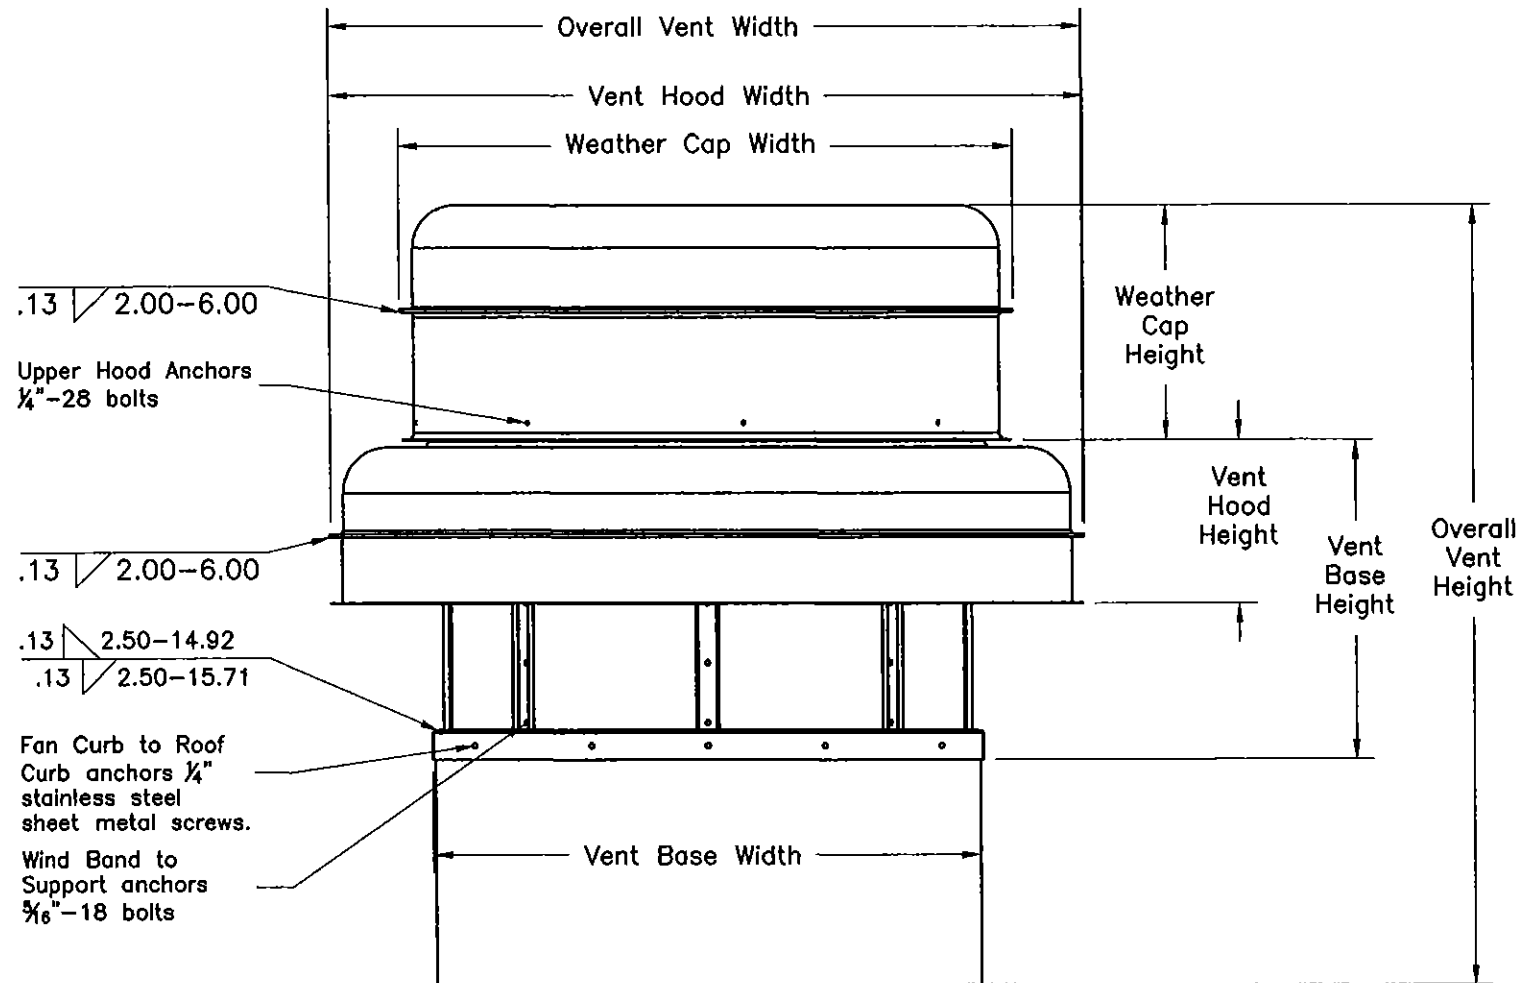

Elevation View - Installation

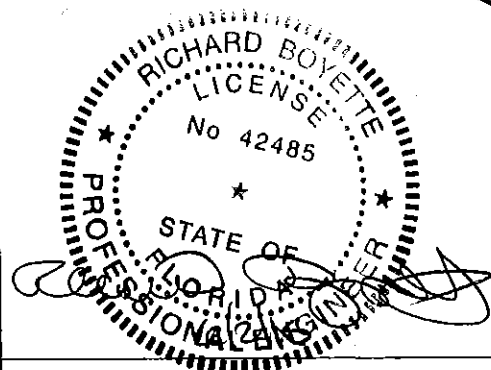

Richard Boyette, FL PE #42485  
Rick Boyette Consulting Inc - CoA #9707  
4031 Coconut Blvd  
Royal Palm Beach FL 33411  
561-790-5766

All dimensions are in inches unless otherwise noted.

Model	Dimensions								Maximum Weight (lbs)			Number of Anchors		
	Overall Vent Width	Overall Vent Height	Vent Hood Width	Vent Hood Height	Vent Base Width	Vent Base Height	Weather Cap Width	Weather Cap Height	Fan	Curb	Total	Fan Curb to Roof Curb	Wind Band to Supports	Upper Hood
PV260	53.00	59.00	53.00	11.77	40.00	23.81	42.60	19.60	319	44	363	24	24	8
PV300	53.00	59.00	53.00	11.77	40.00	23.81	42.60	19.60	365	44	409	24	24	8
PV365	64.00	68.00	64.00	13.08	46.00	24.25	48.60	20.92	466	51	517	28	24	8

Note: Width = Length

PRODUCT REVISED  
to comply with the Florida  
Building Code  
Acceptance No 15-0622.10  
Expiration Date 07/24/2019  
By [Signature]  
Global Trade Product Control

DWG NO.	686790	Sheet 1/3	LET.	REVISION RECORD			BY	CKD.	DATE
TITLE			A	REVISED FOR FLORIDA BUILDING CODE 2014			TCR	TGB	6/2/15
MAT'L									
DRAFTER									
DATE									
DESIGN ENG.									
RELEASED									
CHKD BY									
MFG.									
SCALE									
NTS									

TOLERANCES  
0"-18"=±.030"  
18"-30"=±.060"  
30"-50"=±.120"  
50"& UP=±.180"

Acme Engineering & Manufacturing Corp.  
1820 N. York Street  
Muskogee, OK 74403  
918-682-7791

Large Missile Impact Resistant  
Max rated design pressure : +100.0 / -175.0 PSF



Item	Part Description	Material Description
1	Hood Lower Part	.100 3003-H14 ALUMINUM
2a	PV260/PV300 Hood Upper Part	.050 3003-O ALUMINUM
2b	PV365 Hood Upper Part	.080 3003-O ALUMINUM
3	Weather Cap Upper Part	.050 3003-O ALUMINUM
4	Weather Cap Lower Part	.080 3003-H14 ALUMINUM
5	Mounting Struts	10 GA G90 GALVANIZED STEEL
6	Collar	.080 3003-H14 ALUMINUM
7	Base	.080 3003-H14 ALUMINUM
8	Curb	16 GA G90 GALVANIZED STEEL
9	HOOD SUPPORT BRACKET	.080 3003-H14 ALUMINUM
10	MOTOR STRUT	12 GA G90 GALVANIZED STEEL
11	BEARING STRUT	12 GA G90 GALVANIZED STEEL
12	HORIZONTAL STRUT	12 GA G90 GALVANIZED STEEL
13	DRIVE BASE	12 GA G90 GALVANIZED STEEL

Typical Material tolerances

Material Description	Nominal thickness	Tolerance +/-
.050 3003 ALUMINUM	.050"	.004"
.080 3003 ALUMINUM	.080"	.004"
.100 3003 ALUMINUM	.100"	.005"
16 GA G90 GALVANIZED STEEL	.063"	.005"
12 GA G90 GALVANIZED STEEL	.108"	.009"
10 GA G90 GALVANIZED STEEL	.138"	.009"

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 15-0622-18  
Expiration Date 07/24/2019  
By [Signature]  
Michael Dugg Product Control

Richard Boyette, FL PE #42485  
Rick Boyette Consulting Inc - CoA #9707  
4031 Coconut Blvd  
Royal Palm Beach FL 33411  
561-790-5766

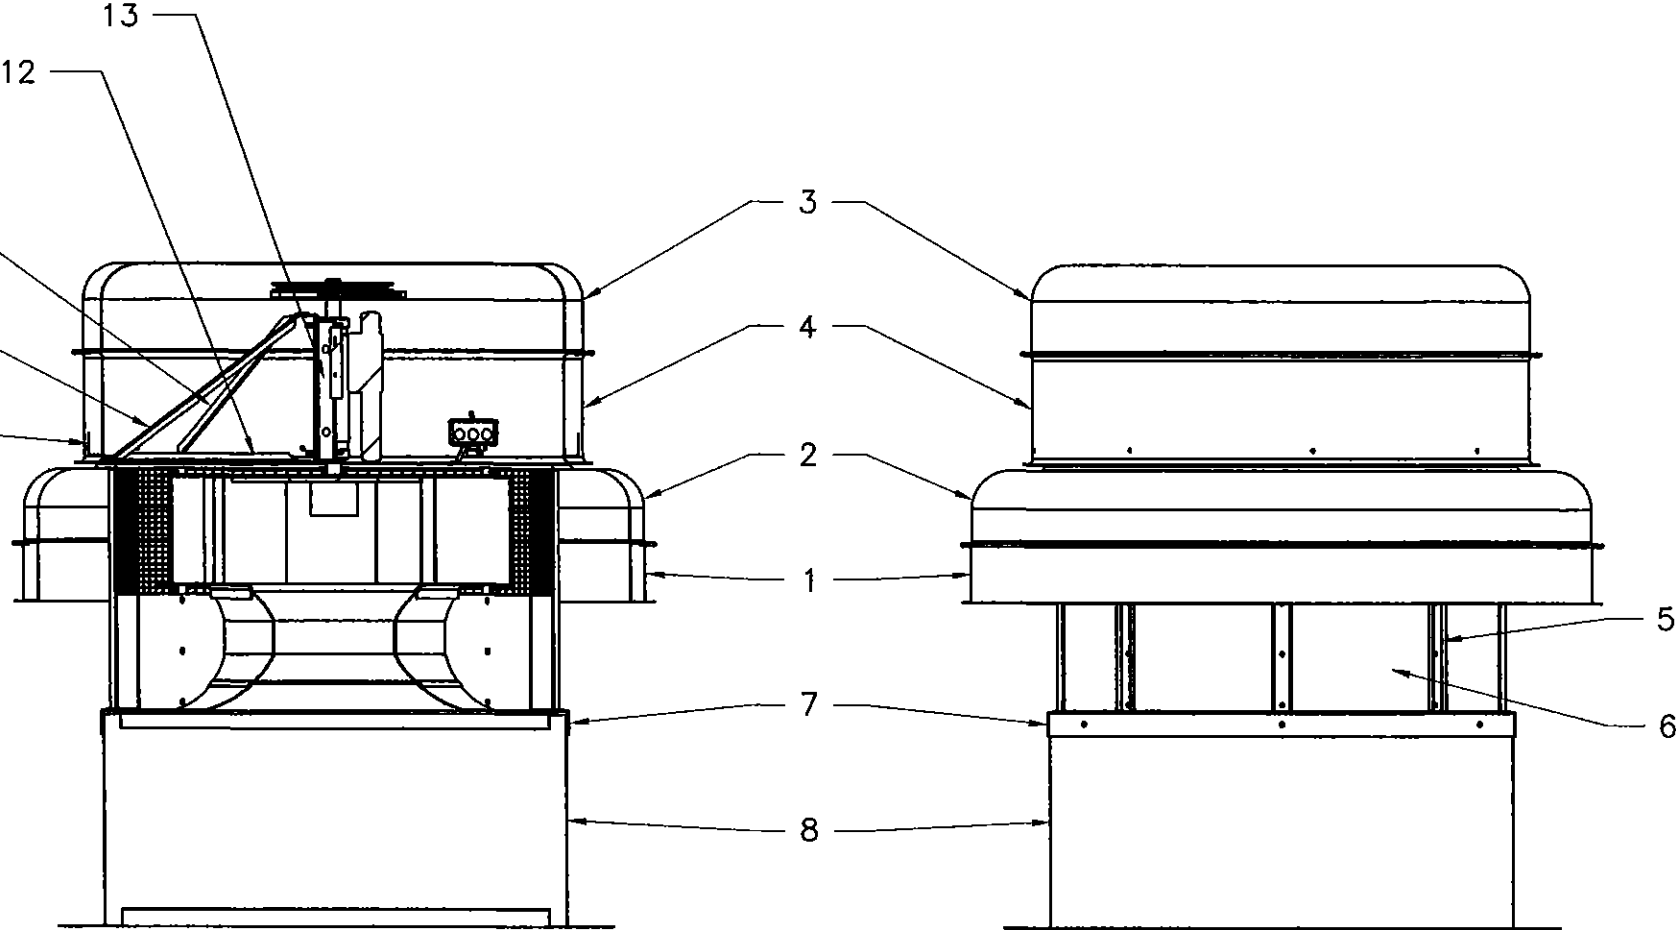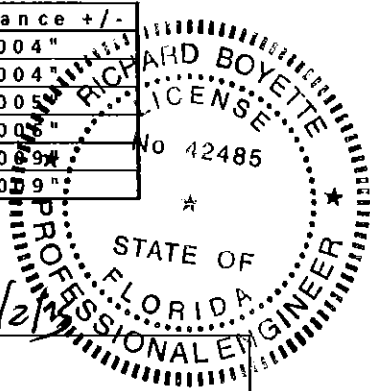

- Notes:
- a. This rooftop exhaust fan has been designed to comply with the Florida Building Code - 2014 Edition.
  - b. Roof structure must be designed to withstand the weight and loading transmitted by this rooftop exhaust fan.
  - c. This approval is for the structural capacity of the exterior housing only, it does not include any interior mechanism and/or electrical part.
  - d. This rooftop exhaust fan has not been tested for wind driven rain according to Florida Building Code, TAS 100(A). It cannot be installed within the ridge area FBC 1523.6.5.2.13.
  - e. All fasteners must be corrosion resistant.

DWG NO. 686790 Sheet 2/3

TITLE LARGE SIZE PV HURR. FANS

DRAFTER	TCR	DATE	3/26/13
DESIGN ENG.	TCR	3/26/13	RELEASED
CHKD BY	MFG.	SCALE	NTS


TOLERANCES  
0"-18"=±.030"  
18"-30"=±.060"  
30"-50"=±.120"  
50"& UP=±.180"

LET.	REVISION RECORD	BY	CKD.	DATE
A	REVISED FOR FLORIDA BUILDING CODE 2014	TCR	TGB	6/2/15


Acme Engineering & Manufacturing Corp.  
1820 N. York Street  
Muskogee, OK 74403  
918-682-7791

Large Missile Impact Resistant  
Max rated design pressure : +100.0 / -175.0 PSF


Wood Deck Installation

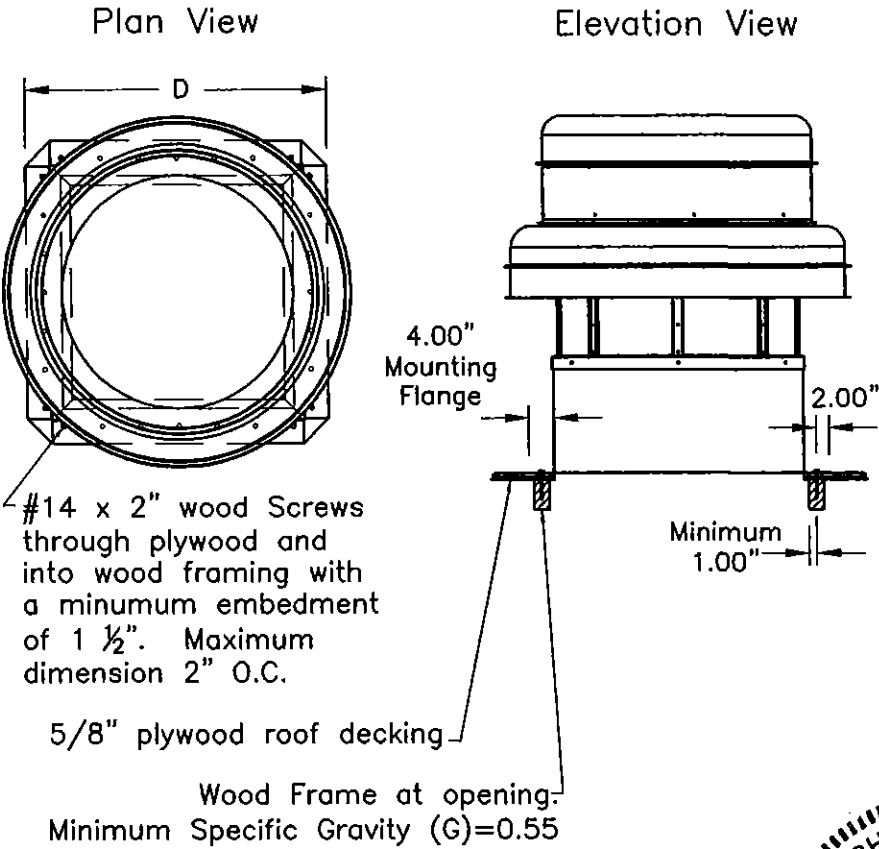

Metal Building Installation

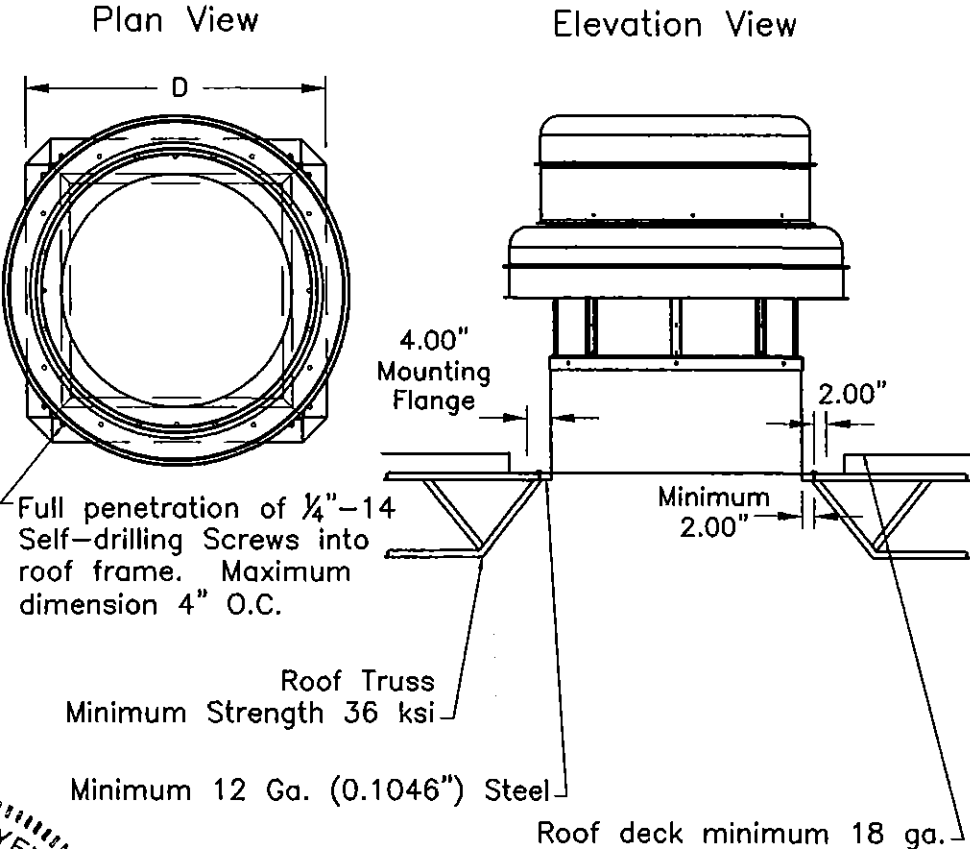

Concrete Deck Installation

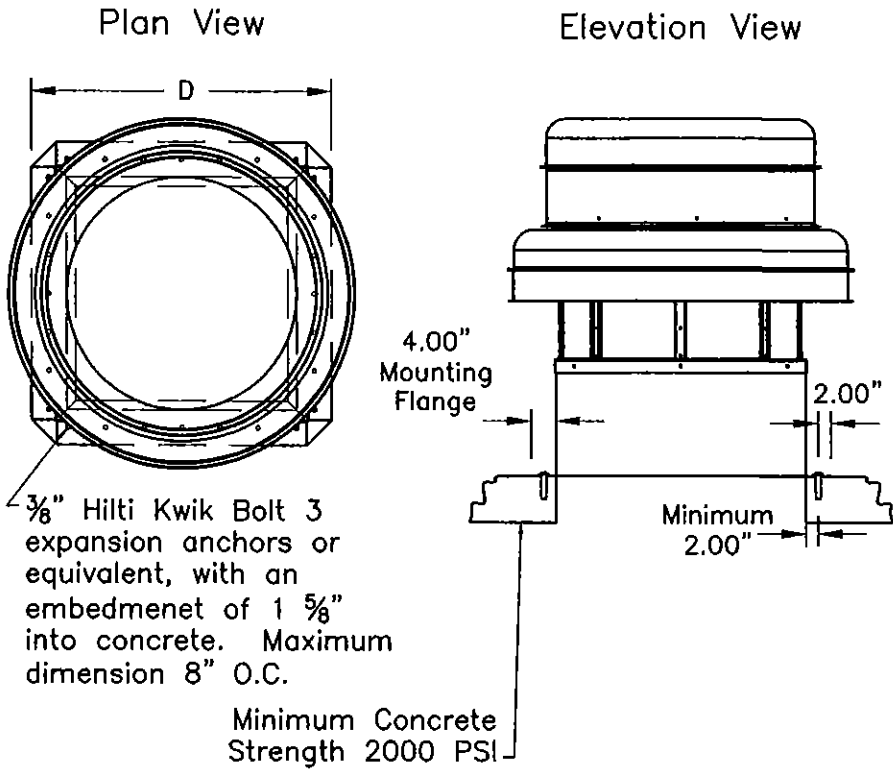

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 15-0622-18  
Expiration Date 07/24/2019  
By [Signature]  
Miami Trade Product Control

*Richard Boyette*  
6/2/19  
RICHARD BOYETTE  
LICENSE  
No 42485  
STATE OF  
FLORIDA  
PROFESSIONAL ENGINEER

Richard Boyette, FL PE #42485  
Rick Boyette Consulting Inc - CoA #9707  
4031 Coconut Blvd  
Royal Palm Beach FL 33411  
561-790-5766

All dimensions are in inches unless otherwise noted.

Fan Curb to Roof Anchors				
Installation Type	Wood Deck	Metal Building	Concrete deck	
Anchor Type	#14 X 2" Wood Screws	1/4" Self Drilling Screws	3/8" Hilti Kwik Bolt 3 or equiv.	
Size	D	# Anchors	# Anchors	# Anchors
PV260	47.7	96	36	24
PV300	47.7	96	36	24
PV365	53.7	108	48	28

DWG NO.	686790	Sheet 3/3	LET.	REVISION RECORD			BY	CKD.	DATE
TITLE	LARGE SIZE PV HURR. FANS		A	REVISED FOR FLORIDA BUILDING CODE 2014			TCR	TGB	6/2/15
MAT'L									
DRAFTER	TGB	DATE	3/26/13						
DESIGN ENG.	TGB	3/26/13	RELEASED						
CHKD BY	MFG.	SCALE	NTS						
			TOLERANCES						
			0"-18"=±.030"						
			18"-30"=±.060"						
			30"-50"=±.120"						
			50"& UP=±.180"						

Acme Engineering &  
Manufacturing Corp.  
1820 N. York Street  
Muskogee, OK 74403  
918-682-7791